

EMERGENCY LED DRIVERS INSTALLATION MANUAL

UL Labeling Requirement

As required by UL standards, installation of this emergency driver mandates the application of the provided Luminaire Modification Label. This label includes the following statement :

“This equipment has more than one power supply connection point.”

The label must be affixed to the fixture housing during installation to indicate the presence of multiple power sources and to ensure compliance with safety and inspection requirements.

What's included

ITEM	QUANTITY
LED Emergency Driver	1
Installation Instruction	1
Wire Nut	13
Safety Rope	1
Wall Anchor	4
Mounting Screw	4

PLEASE READ CAREFULLY AND FOLLOW ALL INSTRUCTIONS FOR YOUR OWN SAFETY

WARNING:

Disconnect both normal and emergency power supplies before installation.

Please read the following instructions applicable to these models.

Make sure all connections are in accordance with the National Electrical Code or Canadian Electrical Code and any local regulations.

CAUTION: Installation is to be performed only by qualified personnel.

CAUTION: This product is for use in indoor fixtures only. Do NOT use near heated air handling outlets, wet locations or hazardous locations.

CAUTION: An unswitched Ac power source is required (100-277/347 VAC, 50/60 Hz)

CAUTION: Do not install near gas or electric heaters.

CAUTION: The use of accessory equipment not recommended by the manufacturer may cause an unsafe condition.

CAUTION: Do not use this product for other than intended use.

CAUTION: Dedicated for UFO High Bay

CAUTION: Equipment should be mounted in locations and at heights where it will not be subjected to tampering by unauthorized personnel.

CAUTION: Use with grounded, UL Listed, damp location rated fixtures and case should be grounding.

CAUTION: Due to sharp edges, handle with care.

CAUTION: Do not attempt to service the battery. A sealed, no-maintenance battery is used that is not field replaceable. Contact the manufacturer for information on service.

IMPORTANT: Please charge the battery consistently for >24 hours for the first time usage so as to activate the whole battery cells of discharging/charging duration.

IMPORTANT: The products are produced with built-in batteries, which could be stocked for one year at most without being used.

DISCLAIMER OF LIABILITY: STREAMER Solutions assumes no liability for damages or losses of any kind that may arise from the improper, careless, or negligent installation, handling or use of this product.

NOTICE: Fixture may become damaged and/or unstable if not installed properly.


IMPORTANT: Emergency lighting is a crucial life safety system , Testing must be performed after installation.

EMERGENCY LED DRIVERS INSTALLATION MANUAL

Ordering Data


Model No.:	Rated Input	Rated Output	Battery Pack	Duration
STB27FC-40WL-LFPB4S2P-DC	100-347Vac,50/60Hz	DC130-190V 37.5W c.p	LiFePO ₄ 12.8V 6.4Ah 81.92Wh	>90 minutes
STB27FCA-40WL-LFPB4S2P-DC	100-277Vac,50/60Hz	DC130-190V 37.5W c.p	LiFePO ₄ 12.8V 6.4Ah 81.92Wh	>90 minutes
STB27FC-40WL-LFPB4S2P-AC	100-347Vac,50/60Hz	AC 120V sine wave 37.5W c.p	LiFePO ₄ 12.8V 6.4Ah 81.92Wh	>90 minutes
STB27FCA-40WL-LFPB4S2P-AC	100-277Vac,50/60Hz	AC 120V sine wave 37.5W c.p	LiFePO ₄ 12.8V 6.4Ah 81.92Wh	>90 minutes

DIMENSIONS

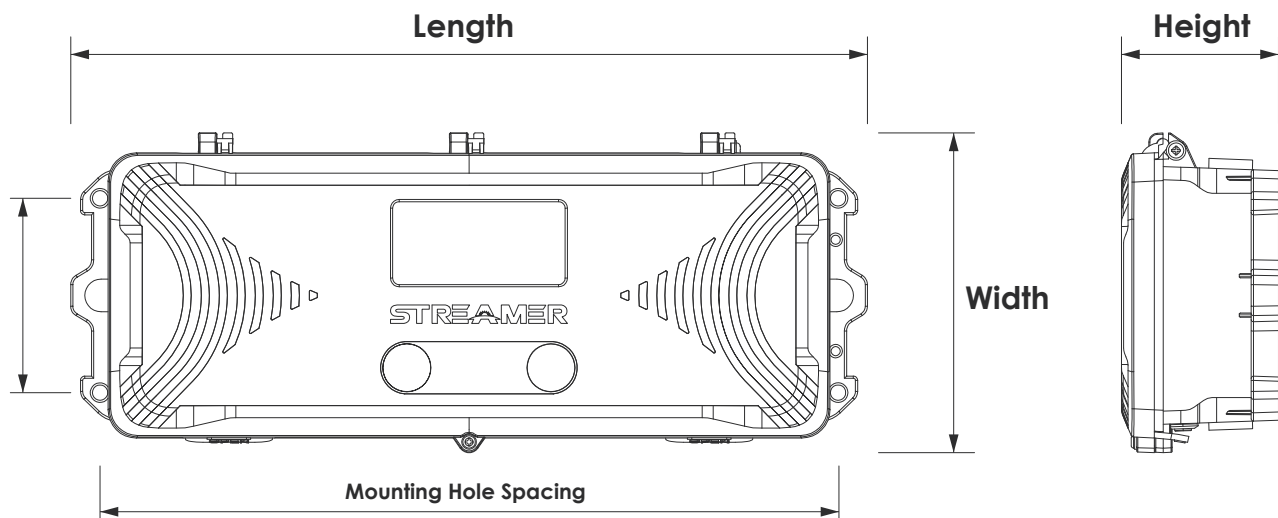

Model No.:	Length	Width	Height	Mounting Hole Spacing
STB27FC(A) Series	14 2/5"(365mm)	5 4/5"(147mm)	2 4/5"(72mm)	13 3/10"(338mm) / 3 1/2"(89mm)

Wiring Diagram

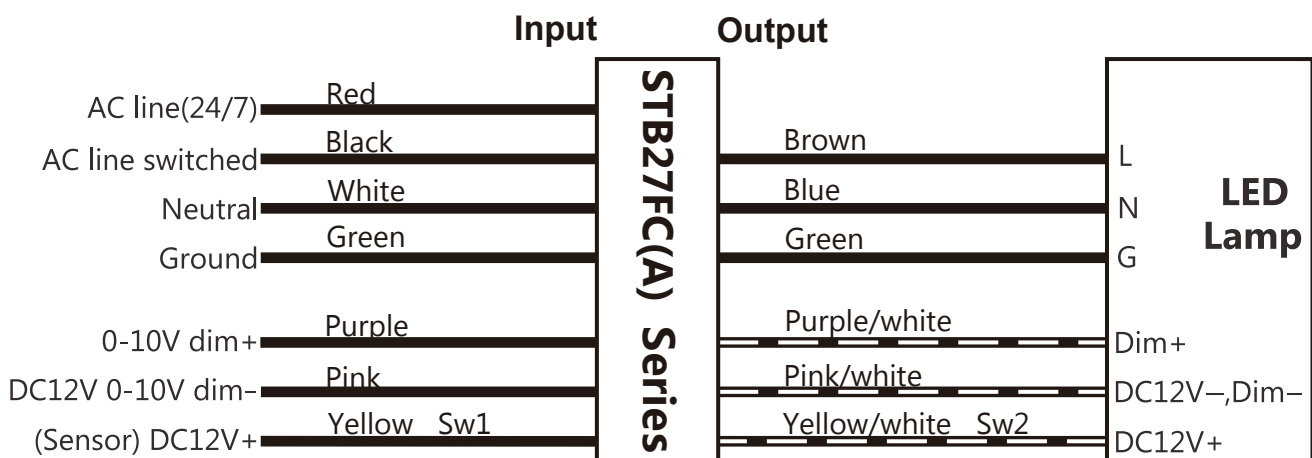

* Sw1, Sw2 Operation

In AC normal mode, Sw1 connects with Sw2.

in DC emergency mode, Sw1 disconnects with Sw2, no output from Sw2.